
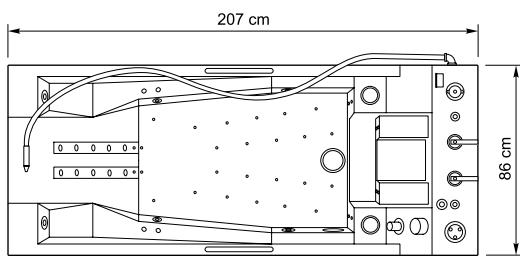
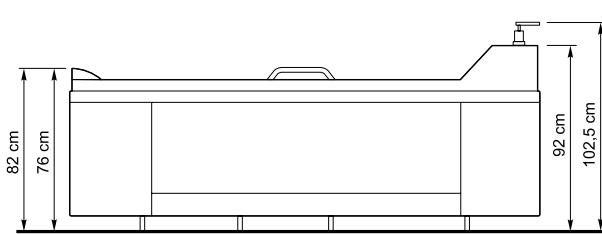


AQUATOR**AQ-27**207 × 86 cm
capacity 350 l**HYDRO, AERO, UNDERWATER SHOWER MASSAGE
AND UNDERWATER VACUUM MASSAGE BATH**UNDERWATER
SHOWER
MASSAGE

USM +


UNDERWATER
VACUUM
MASSAGEHose for USM and
UVM nozzlesNozzles for underwater
shower massage (USM)Nozzle for underwater
vacuum massage (UVM)**MEASURES FOR COMMUNICATIONS**

- Sanitation opening Ø 100 mm (both locations are suitable)
- Hot water (¾" stopcock max. 16 cm high from the floor)
- Cold water (¾" stopcock max. 16 cm high from the floor)
- ◊ Supply wire cable (2 m long)
- ◆ Additional earthing wire cable (2 m long)
- (M) Mineral water (¾" stopcock max. 16 cm high from the floor)

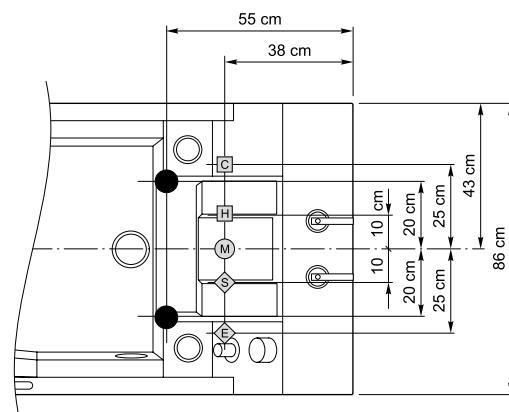

USM-UVM**USM**


- Underwater shower massage (USM)
- Underwater vacuum massage (UVM) (only in the case of USM-UVM)
- Bath

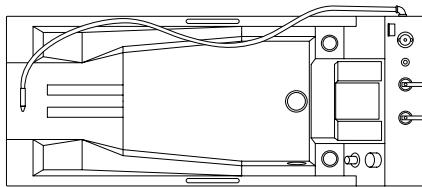**USM-UVM****USM**

Power (kW)	1,5	1,5	1,5	1,5
Current (A)	7,0	4,0	7,0	4,0
Voltage (V)	~230 ..	3 x 400 ..	~230 ..	3 x 400 ..
Frequency (Hz)	50	50	50	50
Nano jets	-	-	-	-
Micro jets	-	-	-	-
Midi jets	-	-	-	-
Air jets	-	-	-	-
USM nozzles	6	6	6	6
UVM nozzle	1	1	-	-

SPA-LUX


- Soft wave hydromassage with four continuously changing zones
- Bath

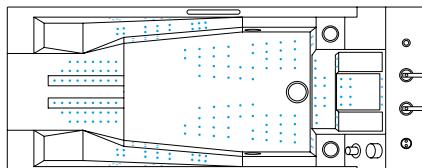

Power (kW)	1,5
Current (A)	7,0
Voltage (V)	~230 ..
Frequency (Hz)	50
• Nano jets	240
Micro jets	-
Midi jets	-
Air jets	-
USM nozzles	-
UVM nozzle	-

HYDRO


- Hydromassage from sides
- Hydromassage from back
- Hydromassage for hands
- Hydromassage for foot
- Bath

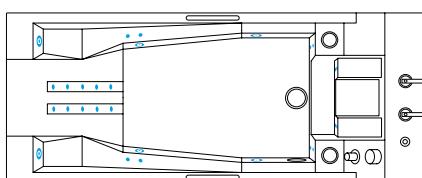

Power (kW)	2,2
Current (A)	4,8
Voltage (V)	~3 x 400 ..
Frequency (Hz)	50
Nano jets	-
• Micro jets	22
• Midi jets	6
Air jets	-
USM nozzles	-
UVM nozzle	-

AERO


- Air massage from bottom
- Bath

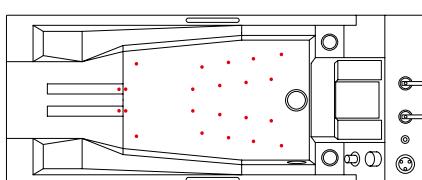

Power (kW)	0,74
Current (A)	1,9
Voltage (V)	~3 x 400 ..
Frequency (Hz)	50
Nano jets	-
Micro jets	-
Midi jets	-
• Air jets	22
USM nozzles	-
UVM nozzle	-

BATH

- Bathtub body
- Frame with adjustable feet
- 2 front and 2 side panels
- Drain
- Hot and cold water stopcock
- Mixer with handshower
- Stainless steel handles

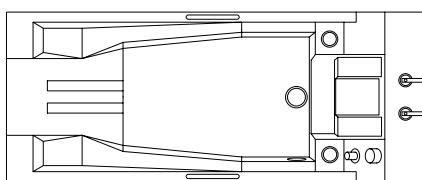

Power (kW)	-
Current (A)	-
Voltage (V)	-
Frequency (Hz)	-
Nano jets	-
Micro jets	-
Midi jets	-
Air jets	-
USM nozzles	-
UVM nozzle	-

**AQUATOR THERAPY BATHS CAN BE ASSEMBLED WITH A SINGLE MASSAGE SYSTEM OR MULTIPLE SYSTEMS.
PLEASE CONTACT OUR SALES FOR FURTHER INFORMATION.**

TECHNICAL DATA**1. WATER PRESSURE IN THE SYSTEM OF UNDERWATER SHOWER MASSAGE DEVICE**

- Nozzle 7 mm 0–0,36 MPa
 Nozzle 9 mm 0–0,33 MPa
 Nozzle 11 mm 0–0,3 MPa

2. TIME FOR FILLING THE BATH

In the case of water pressure in the supplying system about 0,35 MPa and hot and cold water connections $\frac{3}{4}$ " – approximately 4 minutes.

3. TIME FOR DRAINING THE BATH

In the case of sanitation opening in the floor with \varnothing 100 mm and sanitation magistral pipe under the floor with \varnothing 100 mm – approximately 4 minutes.

4. MEASURES FOR CONNECTIONS OF HOT AND COLD WATER – $\frac{3}{4}$ ".**5. MEASURES FOR CONNECTIONS OF MINERAL-, SEA- AND IODINE-BROMINE WATER – $\frac{3}{4}$ ".****6. MEASURE FOR WATER DRAIN CONNECTION – \varnothing 100 mm.**